

Technical Specifications

Materials Mild Steel

Connections ½" Flow and Return

Test Pressure 8 Bar

Testing Authority EN442

Max operation pressure 6 Bar


Max working temperatur@5c


These can be cleaned using a soft damp cloth with a non-abrasive cleaning product.


PLEASE NOTE: That in accordance with Part L1 2006 of the Building Regulations and BS7593:1992 code of practice for the treatment of hot water and central heating systems, we recommend flushing the heating system before installation of new towel rails and then adding the correct quantity and type of inhibitor for use with the towel rail and system to prevent corrosion.

Damage caused to systems not protected by a suitable inhibitor will not be covered by the manufacturer warranty. It is the responsibility of the installer to ensure the correct use and suitability of the fixings provided. No liability for costs or damages arising from failure to do so can be accepted.

Tel: 01727 840344

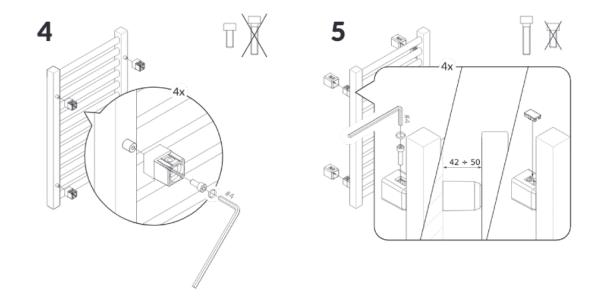

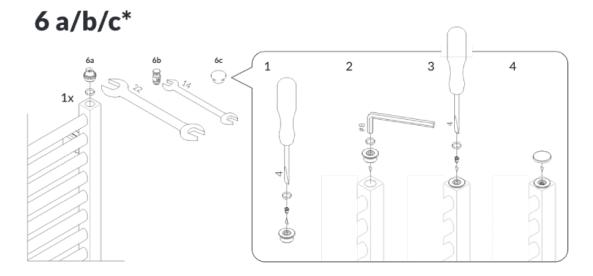





User Manual


Mounting bracket **MKP/MKS** 4x


Tel: 01727 840344

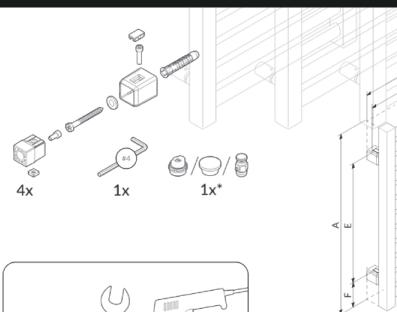








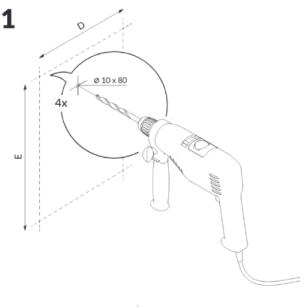

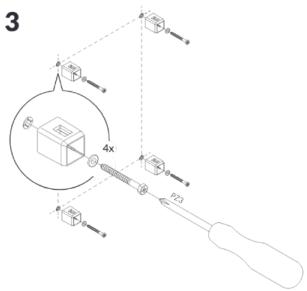

Tel: 01727 840344